




W1 - 2000x1250mm
Schedule item no: 62(b)

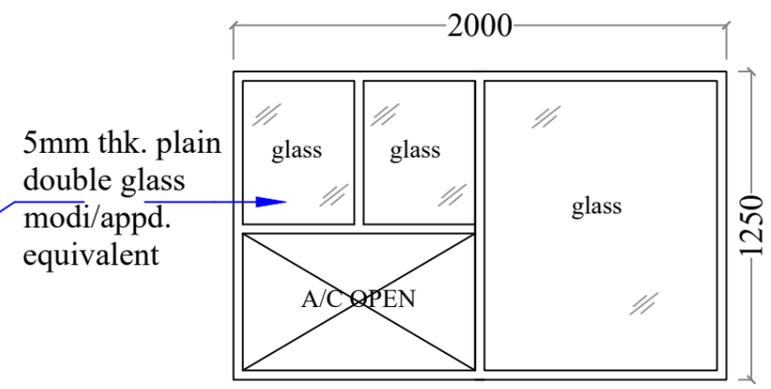


W1AC - 2000x1250mm
Schedule item no: 62(a)

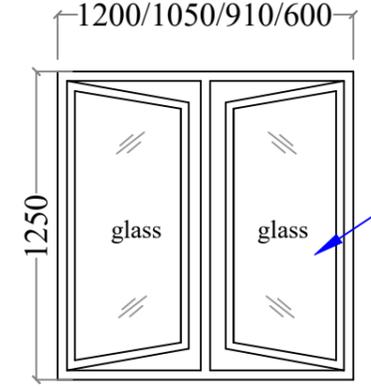


W2 - 1050/1200x1250mm
Schedule item no: 62(c)
W3 - 910x1250mm
Schedule Item no: 62(d)

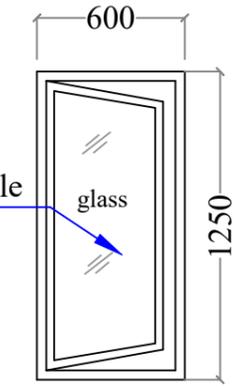


W4 - 600x1250mm
Schedule Item no:62(e)

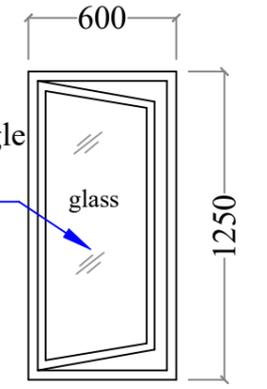


W5 - 600x1250mm
Schedule Item no: 62(f)

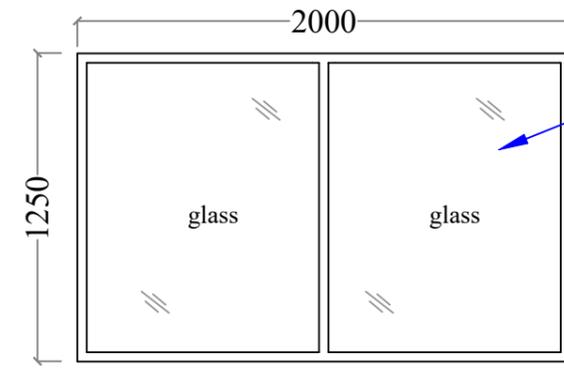


FG1 - 2000x1250mm
Fixed Glazing
Schedule Item no: 62(g)

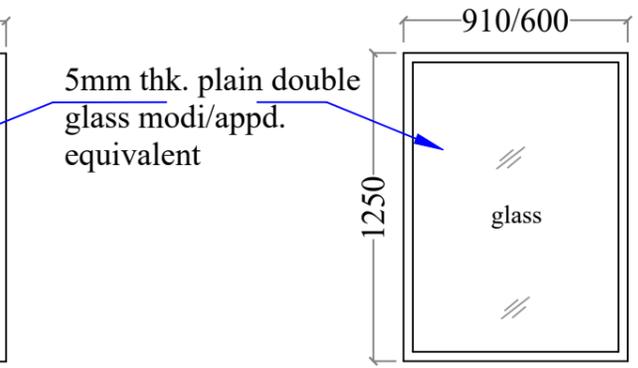

FG3 - 910x1250mm
Fixed Glazing window
Schedule Item no: 62(h)

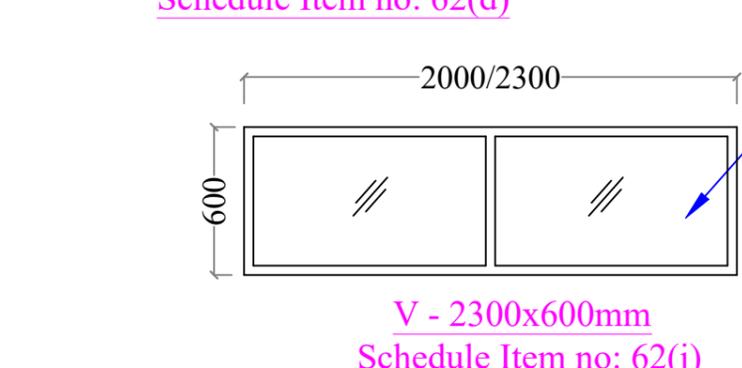

V - 2300x600mm
Schedule Item no: 62(j)

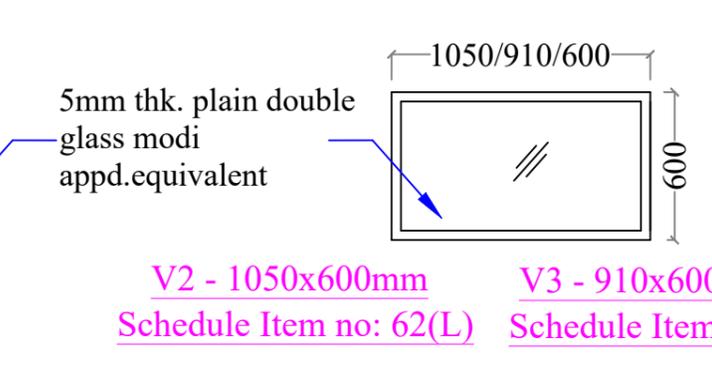


V2 - 1050x600mm
Schedule Item no: 62(L)


V3 - 910x600mm
Schedule Item no: 62(m)

V4 - 600x600mm
Schedule Item no: 62(n)

V1 - 2000x600mm
Schedule Item no: 62(k)



V5 - 600x600mm
Schedule Item no: 62(o)

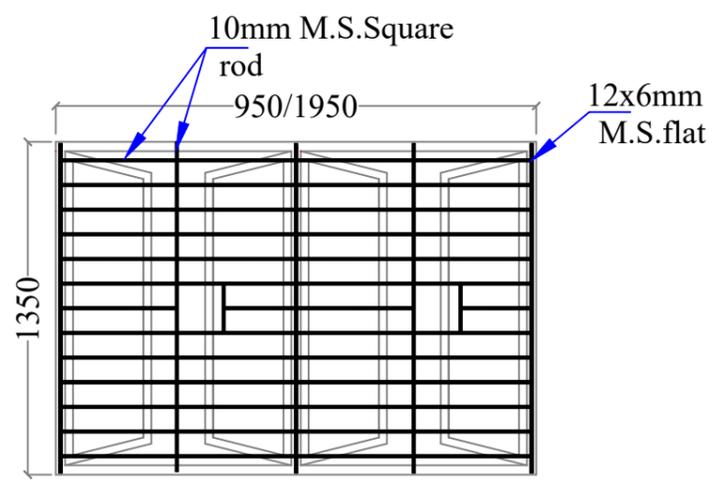

WINDOW/VENTILATOR GRILL (TYPICAL)
(Grill to be measured Separately)
Schedule Item no: 63

NOTES:-

- 1) All NCL joineries are AJANTHA series
- 2) All roll framed section made of galvanized steel colour coated / powder coated (base steel as per IS 513 'D' quality,galvanized as per IS 277 with zinc of 120 GM /Sq.mtr.)
- 3) Sections are to be cut to length ,mitre joined with corner bracket for both outer and shutter frame.
- 4) Corner brackets (45 degree) made of CRCA (Cold rolled close annealed) with zinc phosphating.
- 5) Mullion caps (90 degree) made of glass filled nylon.
- 6) Gaskets made of (EPDM) Ethyl propylene diamine monomer for glass fixing.
- 7) Handles made of high aluminium powder coated and with nylon receiver for windows and ventilators.
- 8) Painting:primer coat with epoxy primer of 5-7 microns thk,finish painted with a polyester paint of 12-16 micronsthk and back coated with Alkyd backer of 5-7 microns or powder coated with pure polyester powder upto 50-60 microns thk.
- 9) Fixing:Frame should be fixed to the existing wall by using Nylon selfexpanding caps and driving MS electroplated 80mm long screws into the caps through frames.
- 10) Grills: Grill made of 10mm sq.MS bars welded to at 150mm c/c, 6X12mm MS flat.Total grill unit should be powder coated.
- 11) 5mm thk. plain glass with 10mm air gap and 5mm thk. plain glass, modi/appd. equivalent.(Double glass)
- 12) All sizes mentioned are approximate to suit site conditions and as per actual measurements.

TENDER PURPOSE ONLY

CHRISTIAN MEDICAL COLLEGE - VELLORE

PROPOSED MODIFICATION OF ENT OPD IN THIRD FLOOR OPD & MAIN BLOCK AT CMC TOWN CAMPUS

NCL WINDOWS

DATE : 20.03.2026	DRG.NO. : CMC/ENT/OPD/J-003	PLANNING ENGINEER:
DRAWN : YAMUNA	CHECKED : DEVAKI	